



NOTE:

ALL DOMESTIC TAPS 2" AND SMALLER REQUIRE A BRASS SERVICE SADDLE EXCEPT ON 4" FIRELINE CONNECTIONS WITH A 1 1/2" UP TO 2" DOMESTIC SERVICE THEN A 4" MJ x 1 1/2" UP TO 2" THD TEE WILL BE USED.

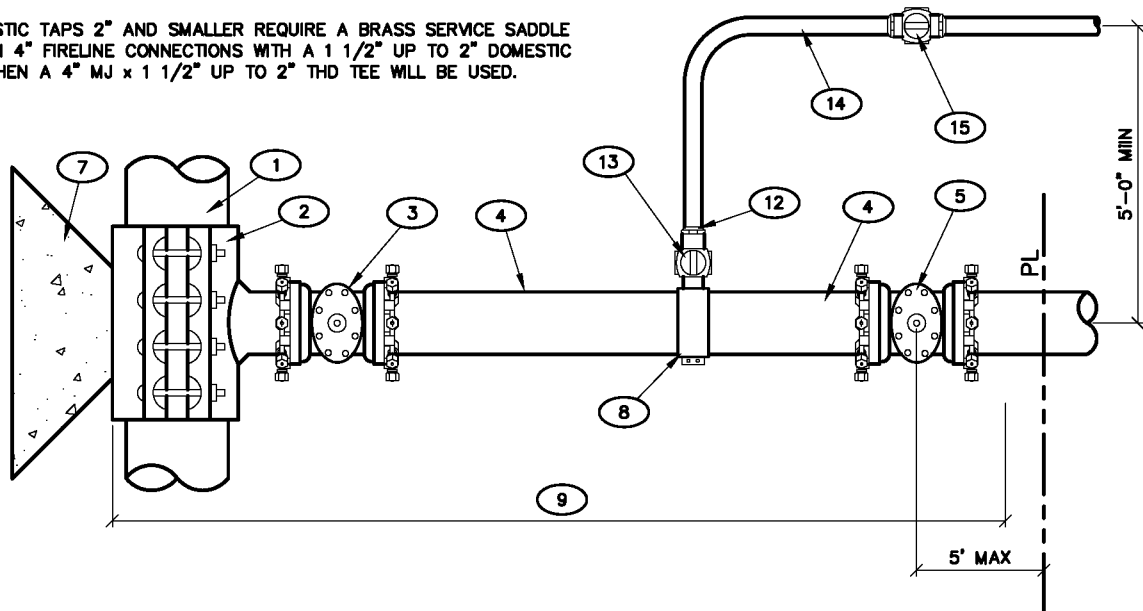

FIRELINE CONNECTION WITH DOMESTIC SERVICE TEE UP TO 2"

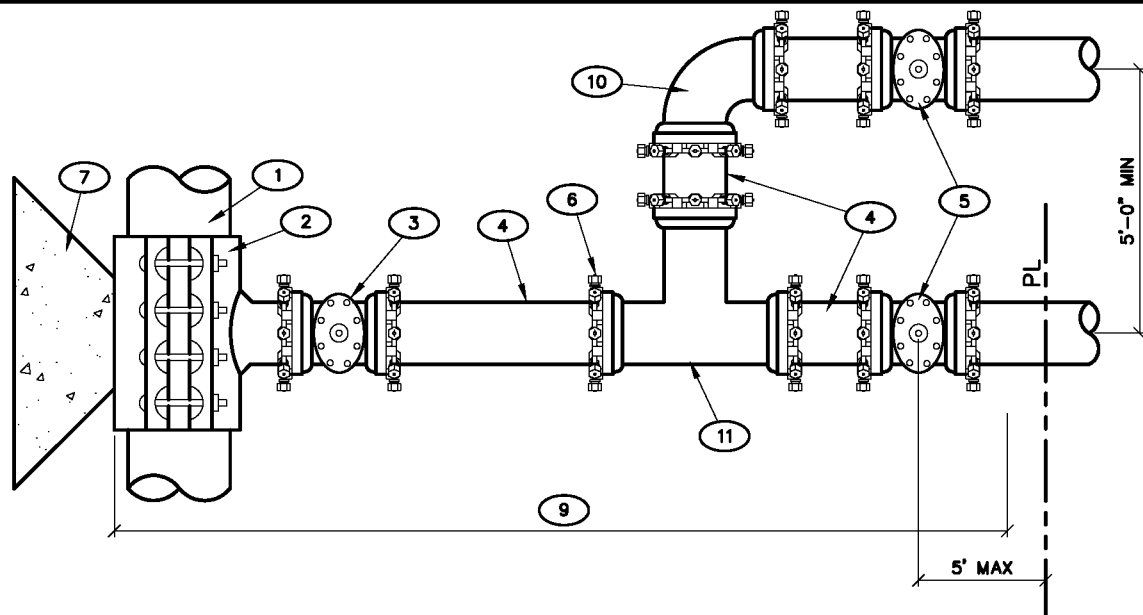

FIRELINE CONNECTION WITH DOMESTIC SERVICE TEE 3" AND LARGER

- ① EXIST MAIN
- ② TAPPING SLEEVE OR SWIVEL TEE
- ③ TAPPING VALVE OR MECHANICAL JOINT GATE VALVE
- ④ DI DBL SPIGOT PIPE
- ⑤ MECHANICAL JOINT GATE VALVE (2' FROM PL)
- ⑥ RESTRAINT DEVICE
- ⑦ CONC KICKBLOCK
- ⑧ BRASS SERVICE SADDLE
- ⑨ POLYETHYLENE WRAPPED
- ⑩ 90° FITTING
- ⑪ MJ TEE
- ⑫ SERVICE INSULATOR
- ⑬ CORP STOP (UP TO 2")
- ⑭ COPPER TUBING (UP TO 2")
- ⑮ CURB STOP

DENVER WATER

1600 West 12th Avenue • Denver, Colorado 80204
Phone (303) 828-6000 • Telecopier No. (303) 828-8851

**FIRELINE CONNECTION WITH
DOMESTIC SERVICE TEE**

Scale: NONE Date: JULY 1995

Drawn: C.B.B. Tr: Ck:

Approved: [Signature] Dr. 127 No. 35